



BID BULLETIN No.2

31 October 2023
(Tuesday)

BIDDING NO.: <p style="text-align: center;">IB23-408235-04</p>	TITLE/DESCRIPTION: <p style="text-align: center;">“ONE (1) LOT SUPPLY, DELIVERY, INSTALLATION, CONFIGURATION, TESTING & COMMISSIONING, AND UPGRADING OF THE CLOSED-CIRCUIT TELEVISION SURVEILLANCE SYSTEM AT DAP CONFERENCE CENTER IN TAGAYTAY”</p>
APPROVED BUDGET CEILING (ABC):	

Reference based on the OBD / Pre-Bid Conference / Site Inspection / Bid Bulletin	Description based on the OBD / Queries	New description / Clarification
<p>Annex A Revised Technical Specifications of the Bid Bulletin No. 1</p> <p>Supply and installation of Dome IP CCTV Camera</p>	<p>Specification:</p> <ul style="list-style-type: none"> •1/3 in. 4MP Progressive-scan CMOS Sensor •Triple-stream Encoding •Smart H.265+ and Smart H.264+ Dual Codec •4MP (2688 × 1520) @30 fps, 2.8, Fixed Lens •Starlight Technology for Low-light Applications •Analytics+ Function –Perimeter Protection and Smart Motion Detection •True Wide Dynamic Range (120 dB) and Day/Night IR Cut Filter •Enhanced Power and Data Transmission Distances (ePoE) •Arctic Pro Series Camera – Operational down to -40deg C(-40deg F) •IP67 Ingress Protection and IK10 Vandal Resistance •with Warranty 	<p>Specification:</p> <ul style="list-style-type: none"> •4-MP 1/1.8" CMOS image sensor, low luminance, and high-



Reference based on the OBD / Pre-Bid Conference / Site Inspection / Bid Bulletin	Description based on the OBD / Queries	New description / Clarification
		<ul style="list-style-type: none">•12 VDC/24 VAC/PoE power supply; ePoE.•IP67 and IK10 protection, heater.•SMD 3.0.•with Warranty



Reference based
on the OBD / Pre-
Bid Conference /
Site Inspection b8:

Note: The Specifications are the minimum standards. The Bidders may submit higher or better specifications.

Reminder to Bidders:

1. Prospective Bidders may obtain further information from DAP and inspect the Bidding Documents at the address given below during Monday to Friday, **9:00AM to 4:30PM**.
2. A complete set of Official Bidding Documents (OBD) may be acquired by interested Bidders until **10 November 2023 (Fri)** from 09:00AM to 04:30PM, of the non-refundable applicable fee for the Bidding Documents, pursuant to the latest Guidelines issued by the GPPB, the cost for the Official Bidding Documents is **THREE THOUSAND FIVE HUNDRED PESOS (P3,500.00)**.

It may also be downloaded free of charge from the website of the Philippine Government Electronic Procurement System (PhilGEPS) and the website of the DAP. In order for bidders to participate, they shall pay the cost of the OBD not later than the scheduled Submission and Opening of the Bids.

3. Interested bidders must make payment to:


Account Name:	Development Academy of the Philippines
Account Number:	0671-0105-40
Bank:	Landbank of the Philippines
Branch of Account:	Pasig Capitol Branch


A copy of proof of payment must be emailed to DAP's Finance Department at: **cashtreasury@dap.edu.ph** for the issuance of Official Receipt (OR) and the



BAC Secretariat will provide assistance to the On-line Bidder for the creation of “**bidms account**” and dedicated site in the **bidms.dap.edu.ph**.

4. In compliance with GPPB Resolution No. 12-2020, all electronic

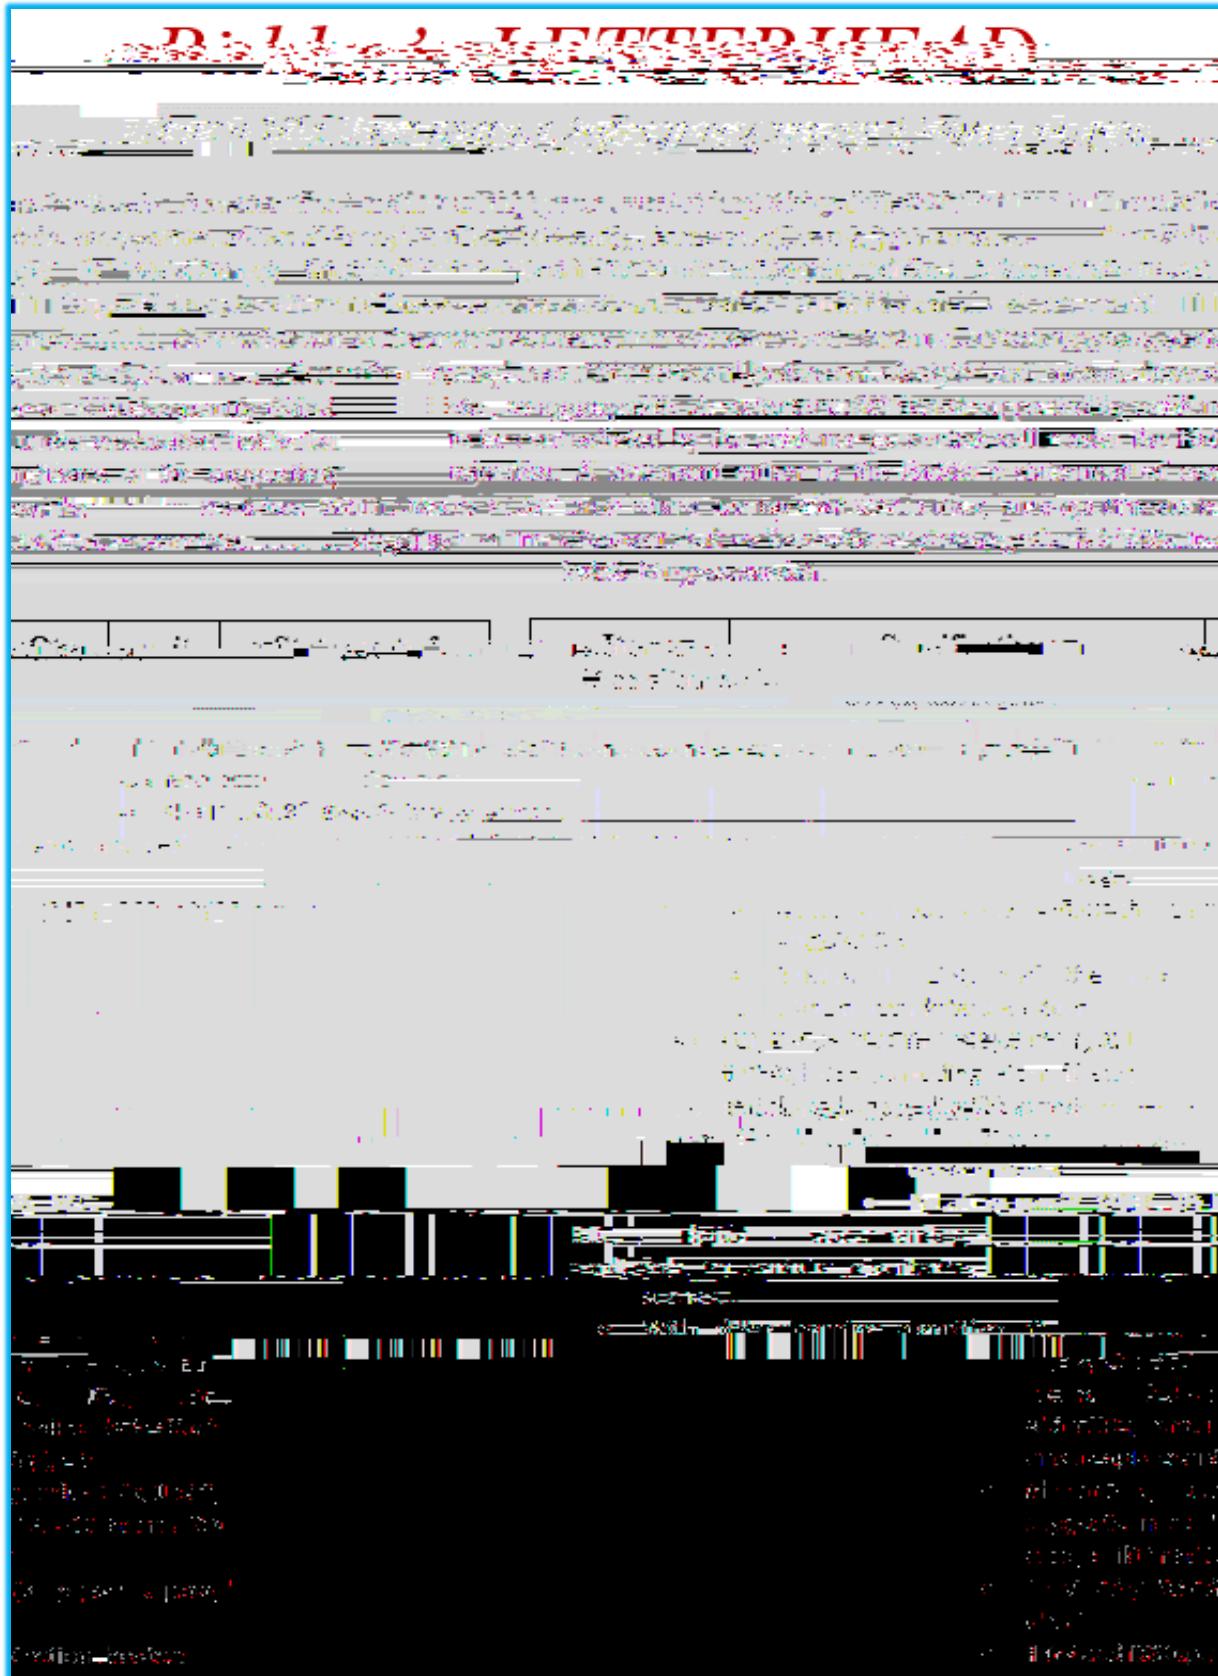



Item	Specification	Qty	unit	Statement of Compliance
	USB, RS232, EPO, SNMP function Port • with Warranty			
1.15 RJ45	• Supply & Installation of RJ45	1.00	lot	
1.16 Cable	• 24 P. 1.U Cable Manager	15.00	sets	

Item	Specification	Qty	unit	Statement of Compliance
1.17	• Supply, installation and termination of fiber optic 4 core multi mode outdoor type	1.00	lot	
1.18	• Supply, installation and termination of fiber optic 4 core multi mode outdoor type	1.00	lot	
Server 11 (Quantity 02) placed in metal cabinet in 194333 (Room 1)				
1.19	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.20	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.21	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.22	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.23	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.24	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.25	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.26	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.27	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.28	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.29	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.30	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.31	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.32	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.33	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.34	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.35	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.36	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.37	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.38	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.39	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.40	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.41	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.42	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.43	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.44	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.45	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.46	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.47	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.48	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.49	• Installation of 4-core multi mode fiber optic cable	1.00	lot	
1.50	• Installation of 4-core multi mode fiber optic cable	1.00	lot	

Item	Specification	Qty	unit	Statement of Compliance
------	---------------	-----	------	-------------------------

Accessories (20)

Accessories (20) - 20 units of accessories for the CCTV system. The accessories include cables, connectors, and other necessary components for the installation and operation of the CCTV system.

2000 - 2000 units of accessories for the CCTV system. The accessories include cables, connectors, and other necessary components for the installation and operation of the CCTV system.

2000 - 2000 units of accessories for the CCTV system. The accessories include cables, connectors, and other necessary components for the installation and operation of the CCTV system.

Side Parking Area 10 CCTV Position 1

Area 8 / Lower Lobby and

Item	Specification	Qty	unit	Statement of Compliance
1000	Installation of 1000 units of CCTV cameras for the Side Parking Area 10.	1000	unit	Installation of 1000 units of CCTV cameras for the Side Parking Area 10.
1000	Installation of 1000 units of CCTV cameras for the Area 8 / Lower Lobby and.	1000	unit	Installation of 1000 units of CCTV cameras for the Area 8 / Lower Lobby and.

1000 - 1000 units of CCTV cameras for the Side Parking Area 10. The cameras are of high resolution and are capable of recording in high definition. They are also equipped with night vision capabilities and are weather-resistant.

1000 - 1000 units of CCTV cameras for the Area 8 / Lower Lobby and. The cameras are of high resolution and are capable of recording in high definition. They are also equipped with night vision capabilities and are weather-resistant.


General Requirements

1000 - 1000 units of CCTV cameras for the Side Parking Area 10. The cameras are of high resolution and are capable of recording in high definition. They are also equipped with night vision capabilities and are weather-resistant.


1000 - 1000 units of CCTV cameras for the Area 8 / Lower Lobby and. The cameras are of high resolution and are capable of recording in high definition. They are also equipped with night vision capabilities and are weather-resistant.

Item	Specification	Qty	unit	Statement of Compliance
1000	Installation of 1000 units of CCTV cameras for the Side Parking Area 10.	1000	unit	Installation of 1000 units of CCTV cameras for the Side Parking Area 10.
1000	Installation of 1000 units of CCTV cameras for the Area 8 / Lower Lobby and.	1000	unit	Installation of 1000 units of CCTV cameras for the Area 8 / Lower Lobby and.

Item	Specification	Qty	unit	Statement of
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
Install of PMU required for system such				
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
Installation of optical fiber				
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]
[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]	[REDACTED]

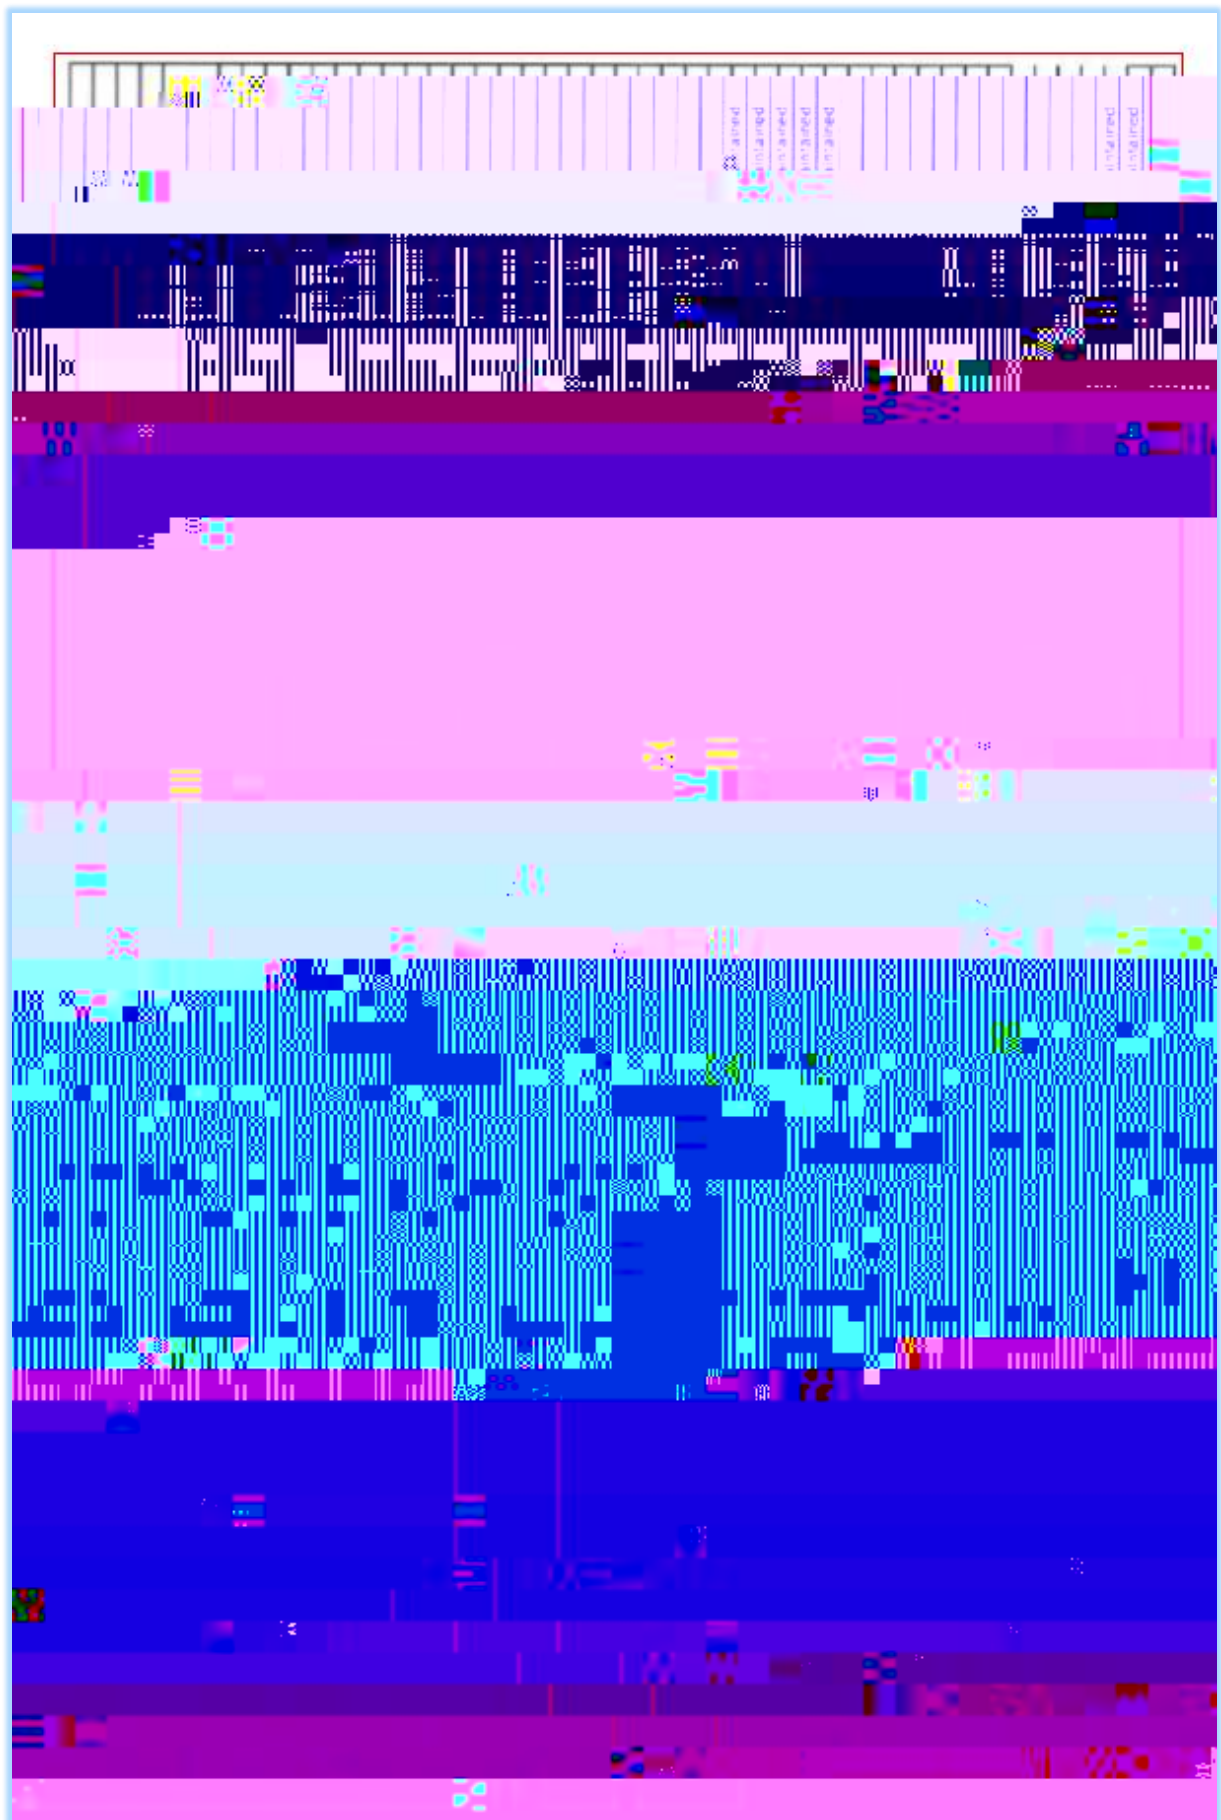



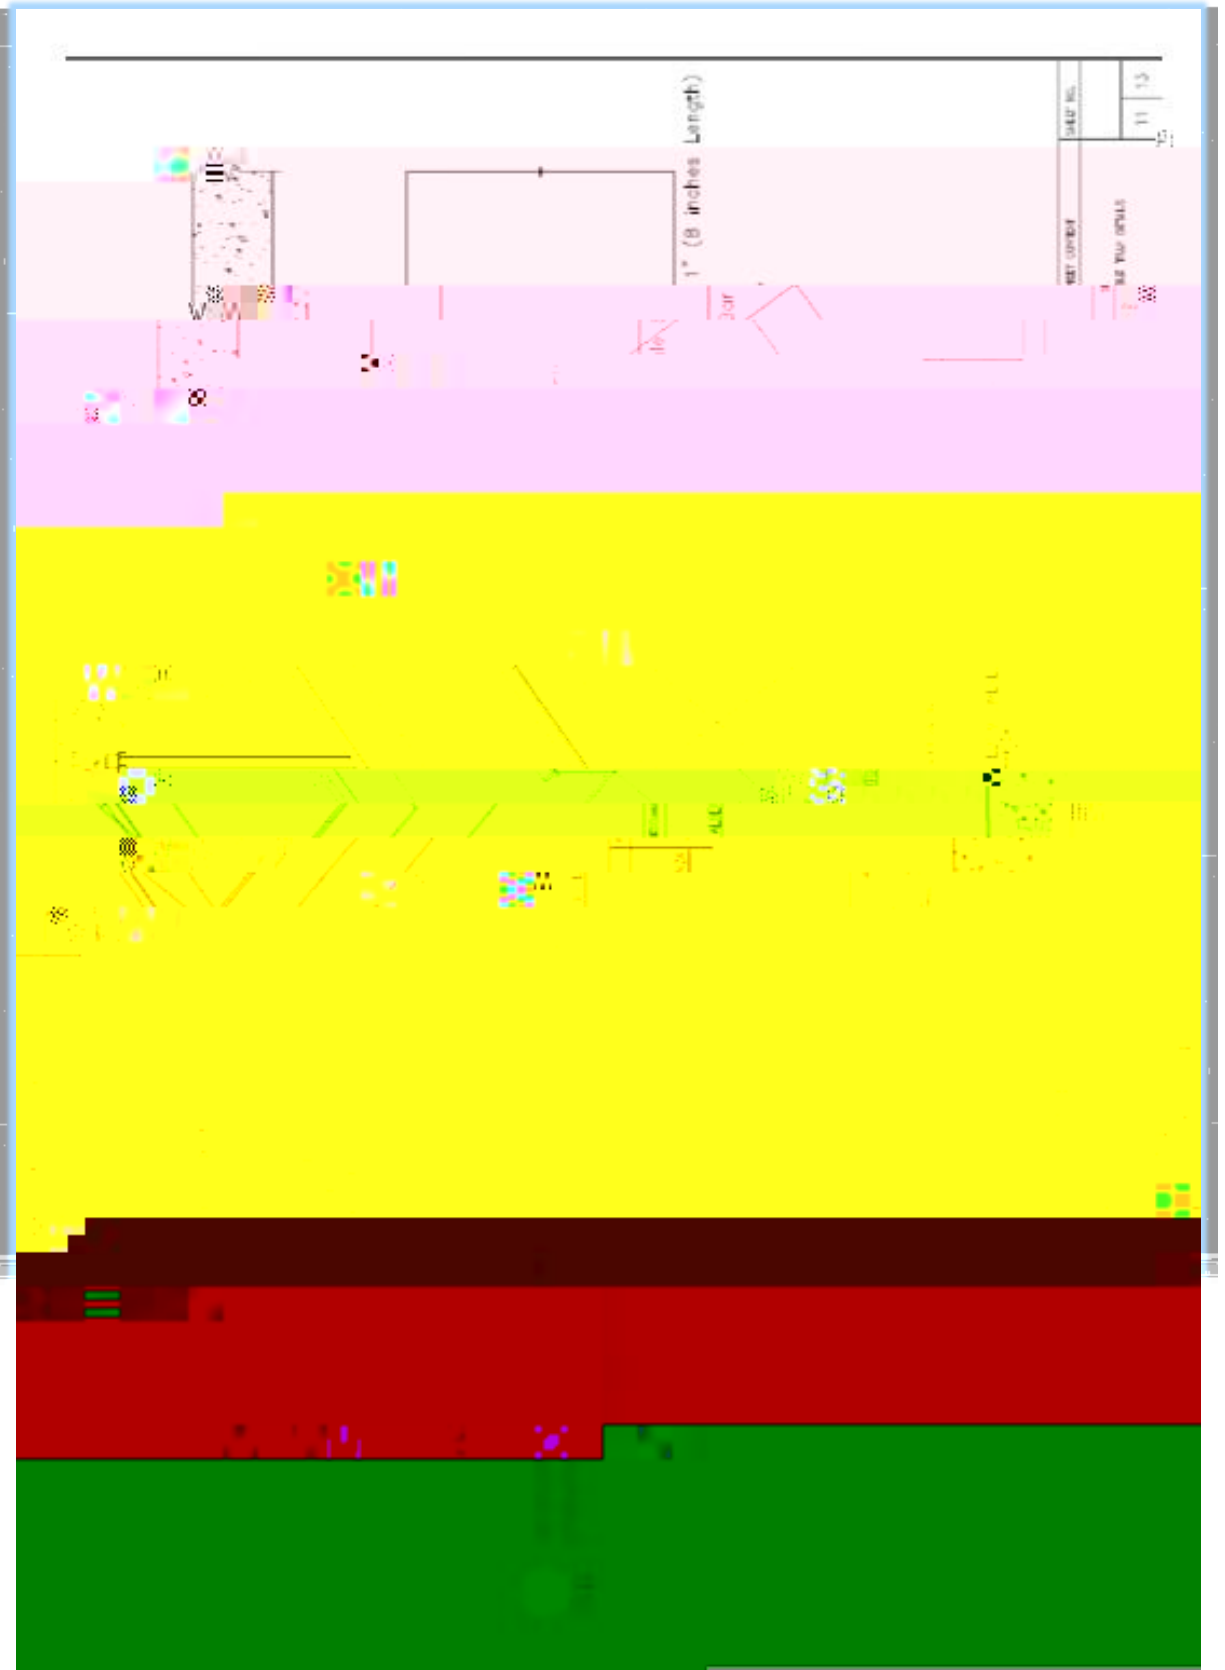


1:08

2nd


Back

develop
philip
P



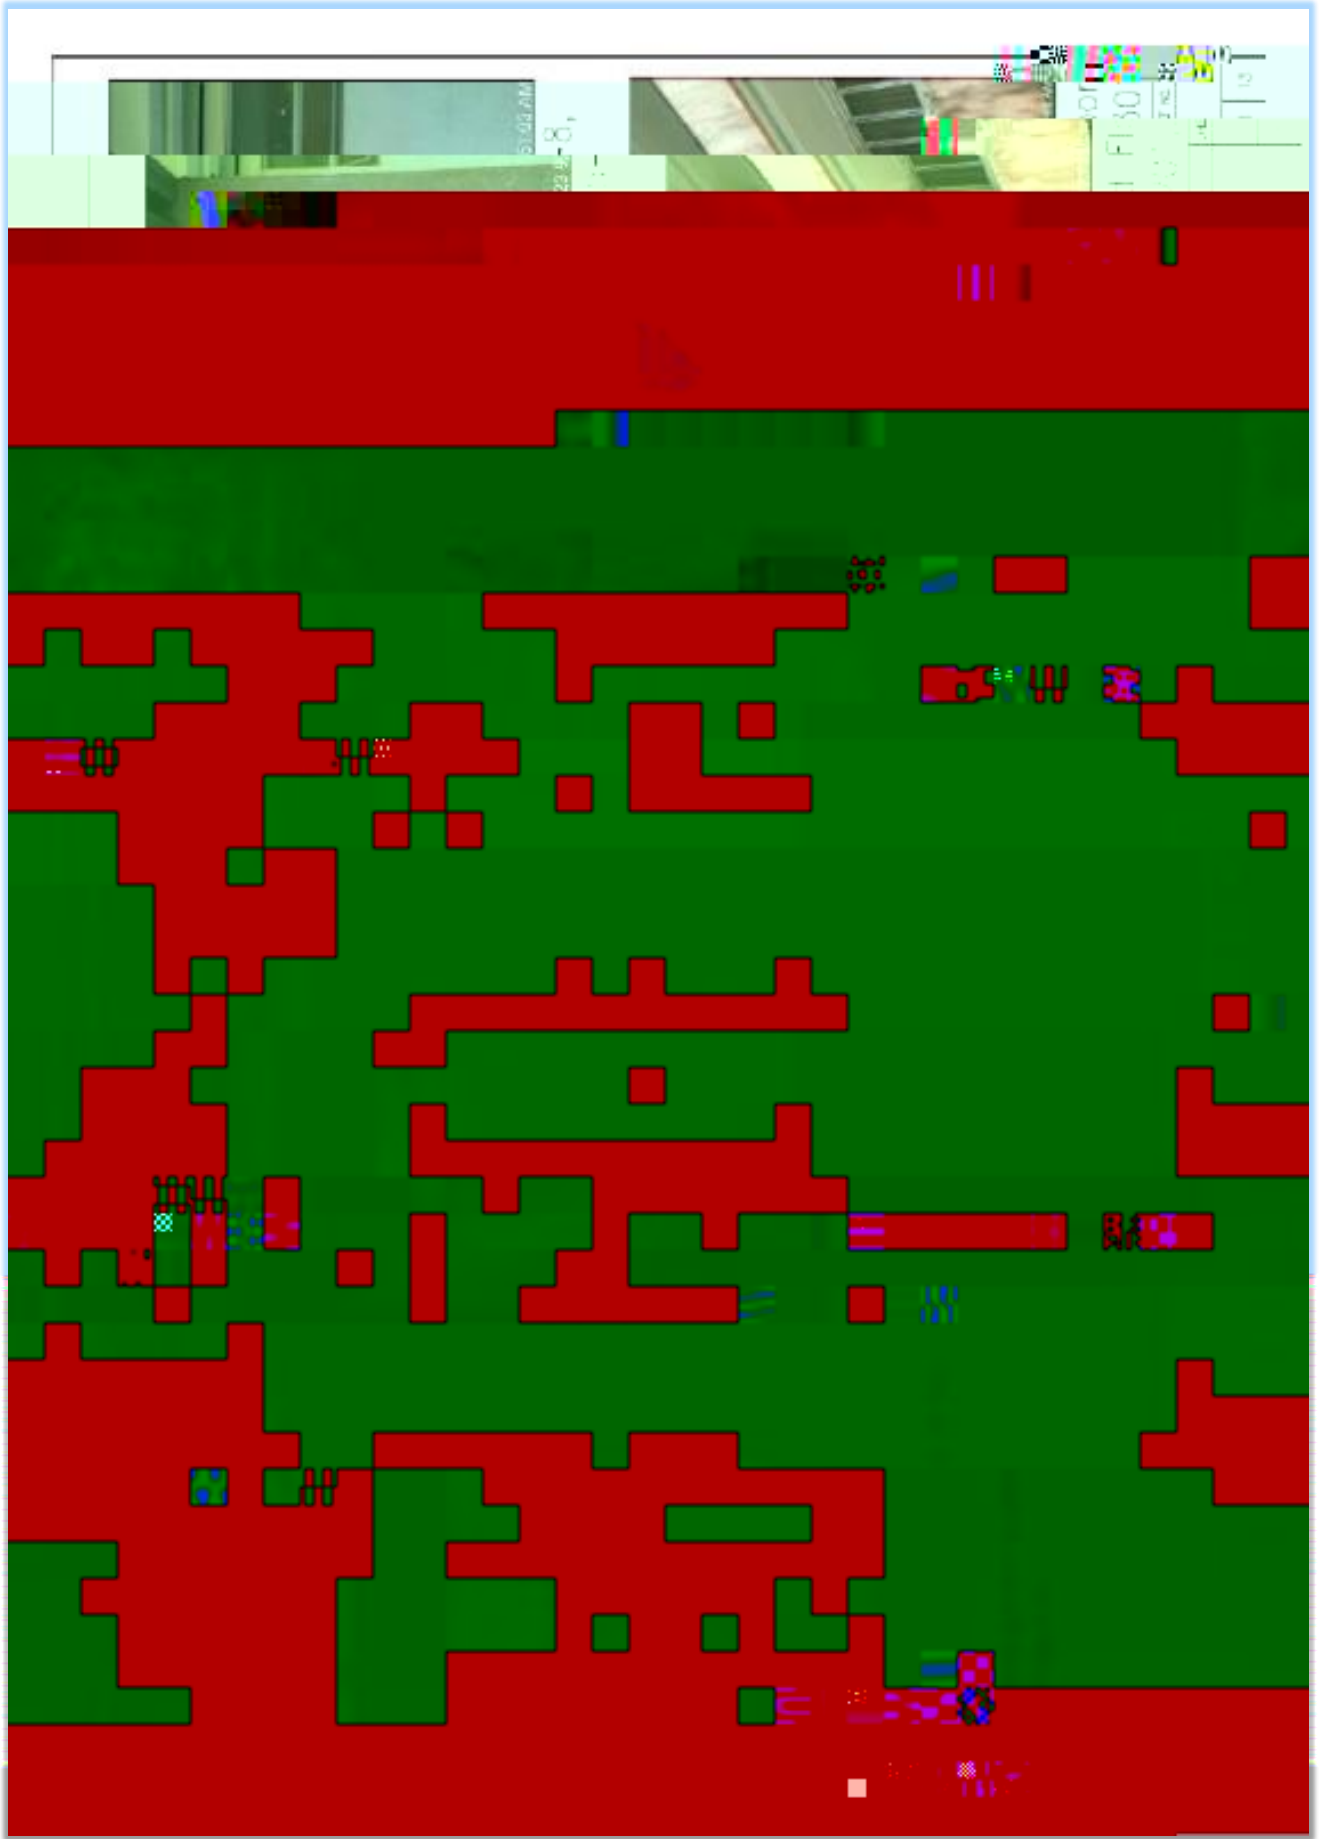



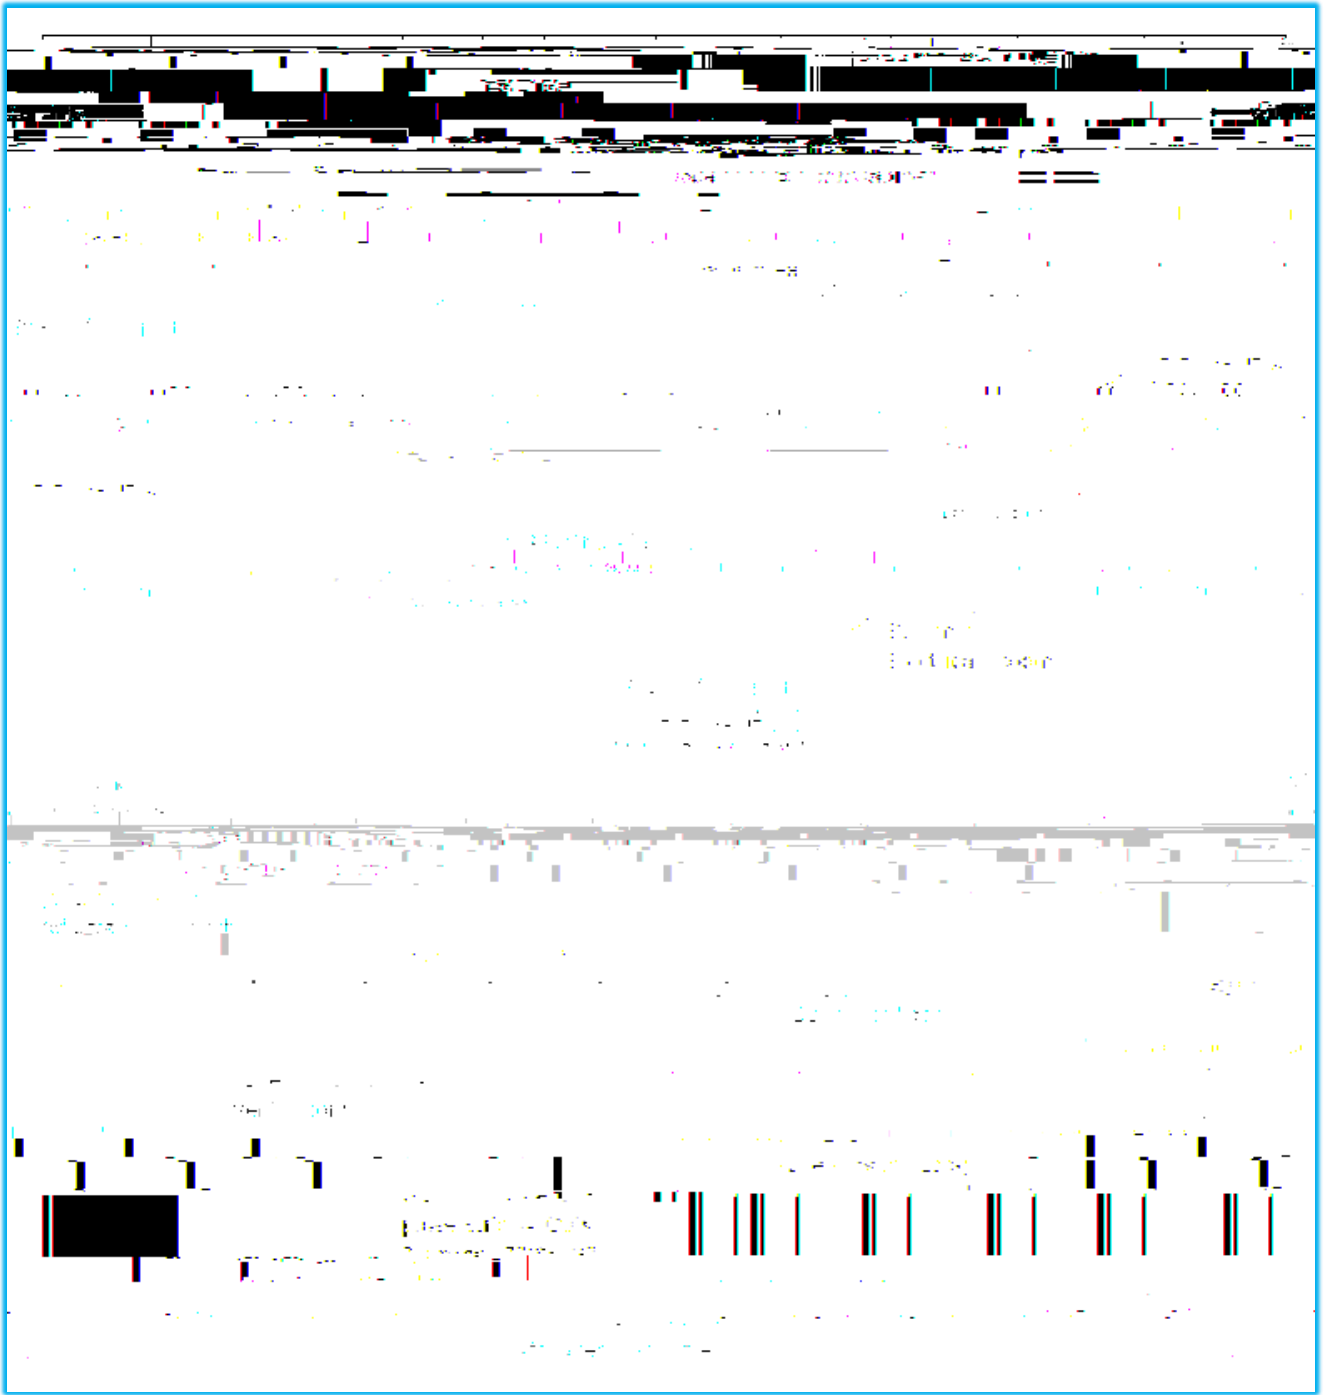

1.13 LC Pigtail	<ul style="list-style-type: none"> Multimode OM3 Simples 1M, 4.0 mm, LSOH; with Warranty 	25.00	pcs						
1.14 Smart-UPS Power Supply	<ul style="list-style-type: none"> Supply & Installation of High frequency, On-line Smart UPS, Rack-Tower Convertible, Hot-Swappable Battery Module Design, 3KVA/2.7 KW, PF: 0.9, 72Vdc, with 6pcs X 9Ah built-in battery, with USB, RS232, EPO, SNMP function Port with Warranty 	1.00	pc						

ROUGH-IN INSTALLATION MATERIALS

1.15	Supply & Installation of 100mm x 100mm x 10mm	1.00	pc		
1.16	Supply & Installation of 100mm x 100mm x 10mm	1.00	pc		
1.17	Supply & Installation of 100mm x 100mm x 10mm	1.00	pc		
1.18	Supply & Installation of 100mm x 100mm x 10mm	1.00	pc		
1.19	Supply & Installation of 100mm x 100mm x 10mm	1.00	pc		

	and Structured cabling from Smart PoE Network Switch at Electrical room located at Dining lobby of two (2) runs each UTP Cable								
--	--	--	--	--	--	--	--	--	--



Installation of 100 (c)		1.41
Roughing in (cable trays, conduits and other necessary laborer);		
Installation of Thirteen 1.00 (c)		1.42
Smart PoE Network Switch		
Smart PoE Network Switch		
Smart PoE Network Switch		
Smart PoE Network Switch		
Smart PoE Network Switch		
Smart PoE Network Switch		
Smart PoE Network Switch		
Smart PoE Network Switch		
Smart PoE Network Switch		
Smart PoE Network Switch		
Smart PoE Network Switch		
Smart PoE Network Switch		

--	--	--	--	--	--	--	--	--

